



Cytomegalovirus DNA Detection and
Quantification, Plasma

Patient ID 321	Patient Name TEST, IMPLEMENTATION TESTING	Birth Date 1956-05-23	Gender F	Age 57
Order Number X100070611	Client Order Number X100070611	Ordering Physician ,	Report Notes	
Account Information C7028846 DLMP Rochester		Collected 12 Jul 2013 08:30		

CMV DNA Detect/Quant, P

SDL



>9100000 IU/mL

Reference Value
Undetected


Abn

Result in log IU/mL is >6.96.
CMV DNA level is >9,100,000 IU/mL (6.96 log IU/mL).

This assay cannot accurately quantify CMV DNA above this level.
The quantification range of this assay is 137 to 9,100,000 IU/mL
(2.14 log to 6.96 log IU/mL) with a limit of detection at 91 IU/mL
(1.96 log IU/mL). Testing was performed by the COBAS
AmpliPrep/COBAS TaqMan CMV Test (Roche Molecular
Systems, Inc.).

Received: 12 Jul 2013 10:57

Reported: 12 Jul 2013 11:08

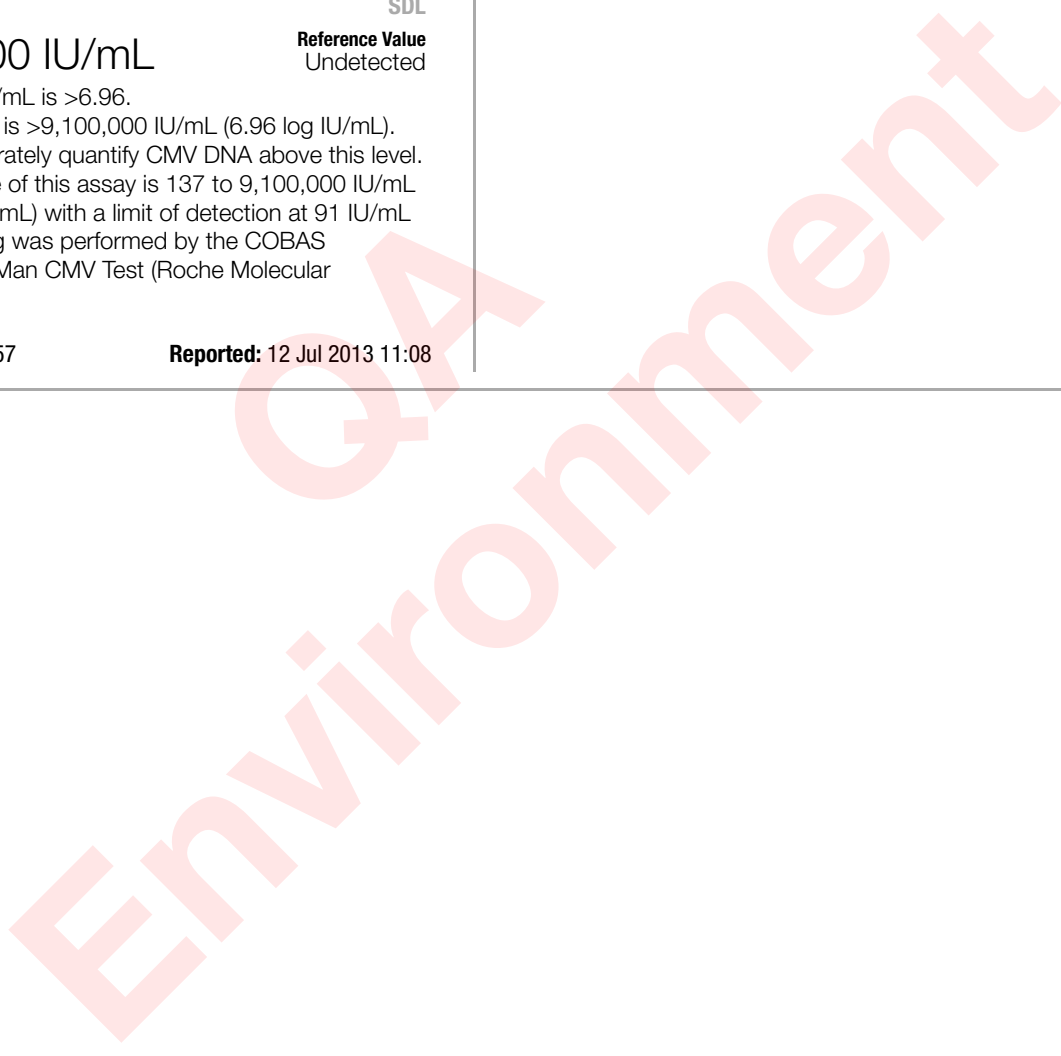

Performing Site Legend

Code	Laboratory	Address
SDL	Mayo Clinic Laboratories - Rochester Superior Drive	3050 Superior Drive NW, Rochester MN 55901